



# MEEKATHARRA WATER RESERVE WATER SOURCE PROTECTION PLAN

## Meekatharra Town Water Supply



WATER RESOURCE PROTECTION SERIES

WATER AND RIVERS COMMISSION REPORT WRP 36

2001



WATER AND RIVERS  
COMMISSION

---

WATER AND RIVERS COMMISSION  
HYATT CENTRE  
3 PLAIN STREET  
EAST PERTH  
WESTERN AUSTRALIA 6004  
TELEPHONE (08) 9278 0300  
FACSIMILE (08) 9278 0301  
WEBSITE: <http://www.wrc.wa.gov.au>

***We welcome your feedback***  
*A publication feedback form*  
*can be found at the back of this publication,*  
*or online at <http://www.wrc.wa.gov.au/public/feedback/>*

*Cover photograph: Main Street, Meekatharra courtesy of the Shire of Meekatharra.*



---

# MEEKATHARRA WATER RESERVE WATER SOURCE PROTECTION PLAN

Meekatharra Town Water Supply

Water and Rivers Commission  
Policy and Planning Division

WATER AND RIVERS COMMISSION  
WATER RESOURCE PROTECTION SERIES  
WRP 36

2001



---

# Acknowledgments

Contribution	Personnel	Title	Organisation
Program Direction	Tony Laws	Manager, Water Quality Protection	Water and Rivers Commission
Supervision	Ross Sheridan	Program Manager, Protection Planning	Water and Rivers Commission
Report Preparation	Wayne Astill	Environmental Engineer	Water and Rivers Commission
Report Preparation	Rueben Taylor	Environmental Engineer	Water and Rivers Commission
Report Preparation	Lisa Mazzella	Environmental Officer	Water and Rivers Commission
Regional Advice	Brett Hall	Water Resources Officer	Water and Rivers Commission
Drafting	Nigel Atkinson	Mapping Contractor	McErry Digital Mapping Pty Ltd

For more information contact:

Program Manager, Protection Planning  
Water Quality Protection Branch  
Water and Rivers Commission  
3 Plain Street  
EAST PERTH WA 6004

Telephone: (08) 9278 0300

Facsimile: (08) 9278 0585

## Reference Details

The recommended reference for this publication is:  
Water and Rivers Commission 2001, *Meekatharra Water Reserve: Water Source Protection Plan, Meekatharra Town Water Supply*, Water and Rivers Commission, Water Resource Protection Series WRP No 36.

ISBN 0-7309-7512-6

ISSN 1326-7442

*Printed March, 2001*



---

# Foreword

## Water source protection plans

Water Source Protection Plans establish the level of protection required within Water Reserves. Protection of water sources is considered a fundamental part of ensuring the provision of a safe drinking water supply.

The plans identify sources of contamination that should be investigated and set out programs for management of the resource. Water Source Protection Plans are developed in consultation with affected landowners, industry groups and relevant Government agencies.

Proclaiming Water Reserves under *the Country Areas Water Supply Act (1947)* protects the quality of water sources in country Western Australia. The Act's by-laws enable the Water and Rivers Commission to control potentially polluting activities, to regulate land use, inspect premises and to take steps to prevent or clean up pollution.

The Water and Rivers Commission aims to work proactively with planning agencies to incorporate water protection in the land planning process. Decisions on land use zoning and subdivision applications have a significant impact on the protection of water sources. The Commission supports the amendment of Town Planning Schemes and Development Strategies that reflect land use compatible with Water Source Protection Plans.

This Water Source Protection Plan provides a basis for establishing compatible land uses within the Water Reserve at Meekatharra and is a mechanism for practical implementation of the Commission's protection strategies. Local government decision-makers, State planning authorities and operational staff are encouraged to recognise this document as a basis for ensuring the long term protection of this groundwater resource for generations to come.

## Water quality protection framework

The Water and Rivers Commission is responsible for managing and protecting Western Australia's water

resources. The Commission has developed policies for the protection of public drinking water source areas (PDWSAs) that include three levels of priority classification.

**Priority 1 (P1)** source protection areas are defined to ensure that there is no degradation of the water source. P1 areas are declared over land where the provision of the highest quality public drinking water is the prime beneficial land use. P1 areas would typically include land under Crown ownership. P1 areas are managed in accordance with the principle of risk avoidance and so land development is generally not permitted.

**Priority 2 (P2)** source protection areas are defined to ensure that there is no increased risk of pollution to the water source. P2 areas are declared over land where low intensity development (such as rural) already exists. Protection of public water supply sources is a high priority in these areas. P2 areas are managed in accordance with the principle of risk minimisation and so some conditional development is allowed.

**Priority 3 (P3)** source protection areas are defined to minimise the risk of pollution to the water source. P3 areas are declared over land where water supply sources need to co-exist with other land uses such as residential, commercial and light industrial developments. Protection of P3 areas is achieved through management guidelines rather than restrictions on land use. If the water source does become contaminated, then water may need to be treated or an alternative water source found.

In addition to priority classifications, well-head protection zones are defined to protect the water source from contamination in the immediate vicinity of production bores. Well-head protection zones are usually circular, with a radius of 500 metres in P1 areas and 300 metres in P2 and P3 areas. These zones do not extend outside water reserves. Special conditions apply within these zones.



---

# Contents

Summary	1	Recommendations	13
1. Introduction	2	Implementation strategy	14
2. Physiography	2	Bibliography	17
3. Hydrogeology	4	Glossary	18
3.1 Water quality	4	Appendix 1	20
4. Existing and proposed land use	4		
4.1 Sheep and cattle grazing	4	Plates	
4.2 Mineral exploration	4	Plate 1. Domestic bore No 5 and surrounding flat topography.....	2
4.3 Crown owned or managed land	4	Plate 2. Production bore 5/85 and elevated fuel tank, similar to production bore 12/85 .....	12
5. Proclaimed area and Priority classification	6		
5.1 Wellhead protection zones	6	Figures	
6. The impact of water source protection planning	6	Figure 1. Meekatharra locality map .....	3
7. Potential for contamination	6	Figure 2. Meekatharra wellfield and Water Reserve ...	5
8. Management of potential water quality risks	6	Figure 3. Potential contaminant threats .....	11
8.1 Protection objectives	6		
8.2 Best management practices	7	Tables	
8.3 Water quality protection notes	7	Table 1. Potential sources of contamination within the Meekatharra Water Reserve .....	8
8.4 Land use planning	7		
8.5 Surveillance and by-law enforcement	7		
8.6 Emergency response	7		



---

# Summary

Meekatharra is a mining and pastoral support centre for the surrounding region, located approximately 700 kilometres north east of Perth in the Shire of Meekatharra. The Water Corporation supplies water to the town from seven bores in the Sherwood wellfield and one bore in the Domestic wellfield.

The water supply bores abstract water from an unconfined alluvial formation. The water source has the potential to be contaminated by accidental spillages from transport along the Great Northern Highway and fuel storage at bores 5/85 and 12/85.

The current Water Reserve is considered adequate to protect the wellfields. The Reserve should be managed for Priority 1 water source protection as it represents the sole supply for the town of Meekatharra.

Any development proposals that may affect the quality of the water supply should be referred to the Water and Rivers Commission for comment.

A draft plan was released for stakeholder comment and submissions received were considered in the preparation of the final plan.



---

## 1. Introduction

Meekatharra services the gold mining and pastoral industries of the nearby region. It is located 700 kilometres north east of Perth and is within the administrative boundary of the Shire of Meekatharra (see Figure 1). The Water Corporation supplies water to the town from two wellfields.

The Sherwood wellfield consists of seven production bores (12/85, 5/86, 2/89, 3/89, 6/89, 7/89 and 11/89) located approximately 12 kilometres north of the town.

The Domestic wellfield consists of one production bore (No. 5) seven kilometres north east of the town.

The wellfields are located in the Meekatharra Water Reserve (see Figure 2). This Reserve was proclaimed in July 1971 under the *Country Areas Water Supply Act, 1947*.

The bores are screened between 15 and 23 metres below ground level. The groundwater is chlorinated before reticulation.

## 2. Physiography

The climate at Meekatharra is semi-arid with high summer temperatures. The rainfall is highly erratic with a long term average of 230 mm per annum. The average annual potential evaporation is more than 10 times the annual rainfall.


About 80% of that rainfall occurs during the winter months between April and September. The remainder falls during summer, and is normally associated with local thunderstorms or southward movement of a tropical cyclone.

Meekatharra is at the edge of a major drainage divide, where surface water flows south to the Saline Lake Annear and north to the Yalgar River. The surface divide is difficult to distinguish due to the flat topography (see Plate 1).



**Plate 1. Domestic bore No. 5 and surrounding flat topography.**



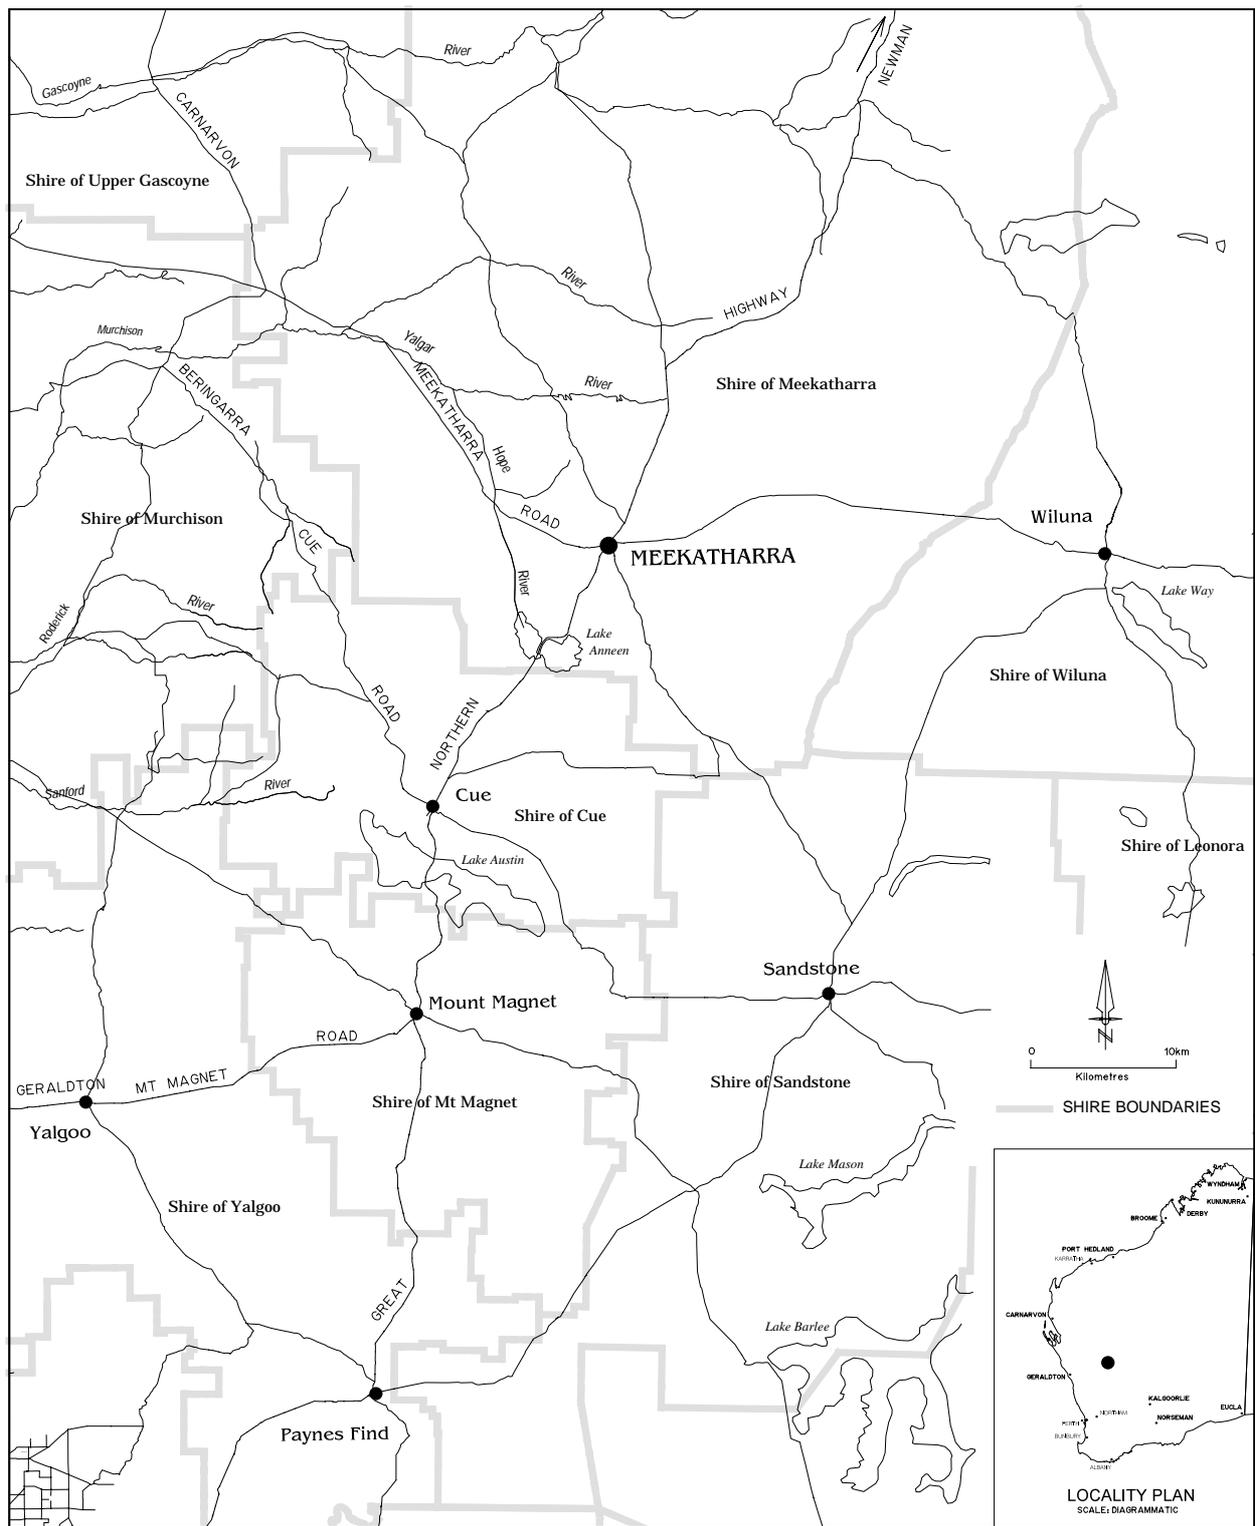

**Figure 1. Meekatharra locality map.**

This map data is in Australian Geocentric Datum 1984 and is not Geocentric Datum of Australia 1994 compliant.



---

### **3. Hydrogeology**

The Meekatharra area is located on the northern extent of the Yilgarn Craton within the Meekatharra – Mt Magnet greenstone belt. The basement rock is overlain with large areas of laterite, however in some areas this laterite has been eroded along current and historical drainage lines. In these areas, the basal rock has been overlain by colluvial and alluvial deposits of sand and clay up to 20 metres thick.

The main groundwater storage is within these thin deposits of alluvial and colluvial material, which are occasionally underlain by fractured rock aquifers. The wellfields draw groundwater from this unconfined alluvial aquifer.

Most rainfall is lost by evaporation or surface runoff. Only a small portion infiltrates the soil and recharges the groundwater. The majority of recharge for the Meekatharra source occurs during rainfall events that result in sustained surface flow events. This sustained flow gives the opportunity for downward percolation of water into the alluvial deposits found in Garden Gully Creek. The catchment for this recharge is difficult to determine due to low relief.

The unconfined aquifer is considered vulnerable to contamination.

#### **3.1 Water quality**

The groundwater quality within the Meekatharra area is generally brackish or saline. However, some bores yield potable or marginal quality water. Bores with potable or marginal quality water are mainly found in the alluvial deposits near the recharge areas.

Salinity in the Domestic and Sherwood wellfields varies between 800 and 1000 mg/L total dissolved salts (TDS).

The level of nitrate (as  $\text{NO}_3$ ) in raw water from production bores ranges from 47 mg/L to 67 mg/L. The NHMRC 1996 Australian Drinking Water Guidelines sets a guideline value of 50mg/L (as  $\text{NO}_3$ ). Nitrate levels exceed the guideline value.

The nitrate levels are naturally occurring in the raw water and are outside the influence of the water source protection planning process. Use of this water for public supply is subject to requirements set by other agencies (Health Department of WA and Office of Water Regulation).

Hardness as  $\text{CaCO}_3$  varies between 200 and 320 mg/L. The NHMRC guideline indicates that  $\text{CaCO}_3$  between 200 and 500 mg/L will increase scaling problems in piping and heating appliances.

### **4. Existing and proposed land use**

#### **4.1 Sheep and cattle grazing**

The major land use within the Water Reserve is sheep and cattle grazing on pastoral leases. The areas around the wellfields are predominantly vegetated with undisturbed mallee scrub.

#### **4.2 Mineral exploration**

Mineral exploration is undertaken within the Water Reserve, however there is no mining at present. It is possible that mining may be undertaken within the Water Reserve in the future.

#### **4.3 Crown owned or managed land**

Land Act Reserve 13931 (Lot 80) is vested in the Water Corporation for water supply purposes. Domestic bore No. 5 is located within this Reserve.

Sheep and cattle from nearby pastoral stations are likely to graze the land as the property is not fenced. A homestead on the Reserve is leased.





---

## 5. Proclaimed area and priority classification

The existing Meekatharra Water Reserve, proclaimed under the *Country Areas Water Supply Act, 1947* should be maintained for the following reasons:

- The key recharge areas for the wellfields are covered by the current boundary;
- Any expansion of the Sherwood wellfield to the north west or south is covered by the existing Water Reserve; and
- Due to the flat nature of the terrain it is difficult to define an accurate surface water catchment.

This Reserve should be managed for Priority 1 source protection as it represents the sole public drinking water source for the town of Meekatharra and the existing land use is compatible with this classification.

The detail of general land use compatibility under each priority classification is outlined in the guidance document titled *Land Use Compatibility in Public Drinking Water Source Areas* (see **Appendix 1**). This document provides general guidance on the compatibility of future land use development. The term “conditional” is used where the land use can usually be compatible with the objectives of source protection, with the adoption of best management practices. Generally, these are practical steps to protect water resources from potential contaminants and cover issues such as fuel and chemical storage and waste disposal.

### 5.1 Wellhead protection zones

Wellhead protection zones are defined over the area around production bores to manage immediate risks to the water source. Each production bore within a P1 source protection area should have a 500 metre radius Wellhead Protection Zone. Development within these areas will be carefully assessed to address immediate water quality risks.

The Commission would have concerns with activities such as tailings dams and fuel and chemical storage being sited in a wellhead protection zone.

## 6. The impact of water source protection planning

The Commission’s water source protection planning recognises existing approvals and does not prohibit currently approved land use activities. The Commission will not place new restrictions on existing land use practices. However, best management practices are encouraged for water quality protection.

It is only when a landowner or leaseholder applies to the Local Government Authority, Department of Environmental Protection or Department of Minerals and Energy to expand an existing operation or develop the land for a new land use type that the Commission will provide advice into the approval process. Advice will be based on the compatibility of the activity with the Priority classification.

## 7. Potential for contamination

Table 1 identifies potential contaminant risks in the proposed Water Reserve and suggests specific protection measures. In the Table, ‘Potential Impact’ indicates the level of risk the issue is to the water source and ‘Likelihood’ indicates the chance of the issue contaminating the water source. Figure 3 identifies the location of the potential contaminant sources.

## 8. Management of potential water quality risks

### 8.1 Protection objectives

The objective of this plan is to protect drinking water in the interest of public health, however the right of existing approved land uses to continue in the Water Reserve is recognised.

The Meekatharra Water Reserve should be managed to ensure there is no degradation of water quality in the aquifer. The Priority 1 classification proposed for the Water Reserve has the fundamental water quality objective of risk avoidance.



---

## 8.2 Best management practices

The adoption of Best Management Practices for land use activities is encouraged to help protect water quality. These are often in the form of an industry code of practice, environmental guideline or Water Quality Protection Note. They are usually developed in consultation with industry groups, producers and State government agencies.

Water Quality Protection Guidelines for Mining and Mineral Processing have recently been released by the Water and Rivers Commission. They have been produced in consultation with the Department of Environmental Protection, Department of Minerals and Energy and key industry representatives.

Education and awareness (eg. Signage and informative material) is a key mechanism for water quality protection.

## 8.3 Water quality protection notes

The Commission has prepared Water Quality Protection Notes to provide information for facilities and activities that may impact on the quality of the State's water resources. These notes provide a basis for developing formal best management practice guidelines in consultation with key stakeholders.

They can be found on the internet via the Commission homepage ( <http://www.wrc.wa.gov.au/protect/policy>).

## 8.4 Land use planning

It is recognised under the State Planning Strategy that the establishment of appropriate protection mechanisms in statutory land use planning processes is necessary to secure the long-term protection of water sources. It is therefore appropriate that the Water Reserve and priority classification be recognised in the Shire of Meekatharra Town Planning Scheme.

## 8.5 Surveillance and by-law enforcement

The quality of public drinking water sources within country areas of the State is protected within Public Drinking Water Source Areas proclaimed under the *Country Areas Water Supply Act 1947*. Declaration of these areas allows by-laws to be established to protect water quality.

The Commission considers by-law enforcement, through on-ground surveillance of land use activities in Water Reserves, as an important water quality protection mechanism. Surveillance, is also important in raising the general level of awareness of the need to protect water quality.

Signs are erected in Water Reserves to advise of the water reserve location, activities that are prohibited or regulated and water quality protection measures.

## 8.6 Emergency response

Escape of chemicals during unforeseen incidents and use of chemicals during emergency response can cause groundwater contamination. The Shire of Meekatharra Local Emergency Management Advisory Committee (LEMAC), through the Meekatharra Emergency Management District, should be familiar with the location and purpose of the Meekatharra Water Reserve. A locality plan should be provided to the Fire and Rescue Services headquarters for the HAZMAT (Hazardous Material) Emergency Advisory Team. The Regional Manager (Mid West) Water Corporation should provide local advice to the HAZMAT Emergency Advisory Team during incidents in the Meekatharra Water Reserve. The Regional Manager, (Mid-West Gascoyne) Water and Rivers Commission should have a broader advisory role to any HAZMAT Emergency Advisory Team.

Personnel who deal with WESTPLAN - HAZMAT (Western Australian Plan for Hazardous Materials) incidents within the area should be given ready access to a locality map of the Water Reserve. These personnel should receive training to ensure an understanding of the potential impacts of spills on the groundwater resource.



**Table 1. Potential sources of contamination within the Meekatharra Water Reserve**

See Figure for location of potential sources of contamination.

Map ref.	Issue	Threats	Risks	Potential Impact	Likelihood	Current Preventative Measures	Suggested Protection Measures
1.	Elevated fuel storage tanks for production bores 5/85 & 12/85. (See Plate 2.)	Two fuel tanks of approximately 2000 litres storage.	Leakage of hydrocarbons.	High - storage tanks are next to production bores.	Moderate.  There is visible evidence on the ground of hydrocarbon contamination.	Earth bunding of fuel tanks.	<ul style="list-style-type: none"> <li>• Electrify bore pumps from power grid or upgrade bunding to Water and Rivers Commission standards (see <i>Water Quality Protection Note - Above Ground Chemical Storage Tanks in PDWSAs</i>).</li> <li>• Procedures should be put in place to minimise risks of spills during refuelling.</li> <li>• Review monitoring program for production bores.</li> <li>• Remove any contaminated soil.</li> </ul>
		Fuel delivery lines are buried. Lines have visible cracks.	Leakage of hydrocarbons.	High - due to close proximity to production bores.	Moderate – fuel lines are internally reinforced with stainless steel.	Reinforced fuel lines	<ul style="list-style-type: none"> <li>• Electrify bore pumps from power grid or assess fuel delivery lines for leakage.</li> <li>• Review monitoring program for production bores.</li> </ul>
		Production bores are not fenced so fuel storage tanks/fuel lines could be prone to vandalism or stock damage.	Leakage of hydrocarbons.	High - storage tanks are next to production bores.	Moderate		Fence production bores and fuel storage areas.
		Fuel storage tanks are located near a small creek so they could be susceptible to damage by flood events.	Leakage of hydrocarbons.	High- storage tanks are next to production bores.	Low to moderate - evidence of bunding being washed away in the past.	Earth bunding of fuel tanks.	Electrify bore pumps from power grid or upgrade bunding to Water and Rivers Commission standards.

Map ref.	Issue	Threats	Risks	Potential Impact	Likelihood	Current Preventative Measures	Suggested Protection Measures
2.	Great Northern Highway traverses the Water Reserve.	<ul style="list-style-type: none"> <li>Road trains and other vehicles use this as a primary transport route.</li> <li>Acute events such as road accidents or spills of fuels or other chemicals.</li> <li>Cumulative impacts from contaminated stormwater runoff.</li> </ul>	Groundwater contamination by hydrocarbons and other chemicals.	High - the road is within the Wellhead Protection Zones for several bores on the upgradient side of the wellfield.	Low – the road is in good condition and there are no sharp bends in the Water Reserve.	<ul style="list-style-type: none"> <li>WESTPLAN-HAZMAT emergency response plan for major spill events is in place.</li> <li>Road is well maintained.</li> </ul>	<ul style="list-style-type: none"> <li>Maintain emergency response plan. Ensure awareness of the Water Reserve and keep relevant personnel informed.</li> <li>Install signs to define the Water Reserve boundary. Signs should include an emergency contact phone number.</li> <li>Review monitoring program for production bores.</li> </ul>
3.	“Old pumper caretakers” accommodation, still in use.	Septic system used for domestic wastewater disposal.	Groundwater contamination from nutrients and bacteria.	Low	Low - the site is about 1 kilometre away from Domestic bore No. 5.	Nil	No intensification of existing land use activities.
N/A	Sherwood and Yoothapina pastoral stations.	Stock grazing in the Water Reserve.	Groundwater contamination from nutrients and bacteria.	Very Low	Very Low	Grazing is extensive with low stocking rates.	Nil

---

<b>Map ref.</b>	<b>Issue</b>	<b>Threats</b>	<b>Risks</b>	<b>Potential Impact</b>	<b>Likelihood</b>	<b>Current Preventative Measures</b>	<b>Suggested Protection Measures</b>
N/A	Various minor exploration, mining and prospecting leases.	Temporary fuel handling and storage.	Groundwater contamination by hydrocarbons.	Moderate	Low	DEP licence conditions and DME mining, prospecting and exploration lease approvals.	DEP licence conditions and DME approvals should be reviewed according to Water and Rivers Commission standards for PDWSAs upon renewal. New DEP Works Approvals should also meet Commission standards for PDWSAs.





**Plate 2. Production bore 5/85 and elevated fuel storage tank. Similar to production bore 12/85.**



---

# Recommendations

1. Land planning strategies, such as the Shire of Meekatharra Town Planning Scheme, should incorporate the management principles outlined in the Water and Rivers Commission's *Land use compatibility in Public Drinking Water Source Areas* (see **Appendix 1**) and reflect the Priority 1 classification given to the Meekatharra Water Reserve.
2. All land use development proposals in the Meekatharra Water Reserve that are classified as 'conditional' or 'incompatible' (refer to **Appendix 1**) should be referred to the Water and Rivers Commission for assessment. This includes Department of Environmental Protection licence renewals and Works Approval applications and Notices of Intent for Department of Minerals and Energy mining, prospecting and exploration leases.
3. Signs should be erected along the boundary of the Water Reserve to define the location and promote public awareness of the need to protect water quality. Signs should include an emergency contact number.
4. Incidents covered by WESTPLAN – HAZMAT in the Meekatharra Water Reserve should be addressed through the following measures:
  - (i) The Meekatharra Local Emergency Management Advisory Committee (through the Meekatharra Emergency Management District) being familiar with the location and purpose of the Meekatharra Water Reserve.
  - (ii) The locality plan for the Meekatharra Water Reserve being provided to the Fire and Rescue Services headquarters for the HAZMAT Emergency Advisory Team.
  - (iii) The Water Corporation providing local advice to the HAZMAT Emergency Advisory Team during incidents in the Meekatharra Water Reserve.
  - (iv) The Regional Manager, Water and Rivers Commission to have a broader advisory role to any HAZMAT Emergency Advisory Team.
  - (v) Personnel dealing with WESTPLAN - HAZMAT incidents in the area given ready access to a locality map of the Water Reserve and training to understand the potential impacts of spills on the groundwater resource.
5. A surveillance program should be implemented to identify any incompatible land uses or potential contaminant risks within the Water Reserve. Implementation of the surveillance should be delegated to the Water Corporation.
6. Monitoring program reviews should address the risks identified in this plan. Water quality data should continue to be reviewed regularly to identify any adverse trends.
7. Bores 5/85 and 12/85 should be either electrified or the fuel storage bunding and transfer upgraded according to Water and Rivers Commission standards.
8. Fence remaining production bores and associated fuel storage areas.
9. Implementation of these recommendations should be reviewed annually. A full review of this Water Source Protection Plan should be undertaken after five years.



## Implementation strategy

No	Description	Implemented by	Timing
1.	Incorporation of Meekatharra Water Reserve into land planning strategies.	Shire of Meekatharra, Ministry for Planning.	Ongoing.
2.	Referral of development proposals.	Shire of Meekatharra, Ministry for Planning, Department of Minerals and Energy, Department of Environmental Protection and Mid-West Development Commission.	Ongoing.
3.	Erection of signs:  (i) Development of guidelines for signage.  (ii) Determine number and location of signs required around the boundary of the Water Reserve.  (iii) Erect signs.	(i) Program Manager, Protection Planning (WRC).  (ii) Regional Business Manager, Mid-West Gascoyne Region (WRC)/ Regional Business Manager, Mid-West Region (WC).  (iii) Regional Manager, Mid-West Gascoyne Region (WRC)/ Regional Business Manager, Mid-West Region (WC).	(i) 2001/02.  (ii) 2001/02.  (iii) To be determined.

No	Description	Implemented by	Timing
4.	<p>Incidents covered by WESTPLAN – HAZMAT in the Meekatharra Water Reserve should be addressed through the following measures:</p> <p>(i) The Meekatharra Local Emergency Management Advisory Committee (through the Meekatharra Emergency Management District) being familiar with the location and purpose of the Meekatharra Water Reserve.</p> <p>(ii) The locality plan for the Meekatharra Water Reserve being provided to the Fire and Rescue Services headquarters for the HAZMAT Emergency Advisory Team.</p> <p>(iii) The Water Corporation to provide local advice to the HAZMAT Emergency Advisory Team during incidents in the Meekatharra Water Reserve.</p> <p>(iv) The Water and Rivers Commission, Regional Manager should have a broader advisory role to the HAZMAT Emergency Advisory Team during incidents in the Meekatharra Water Reserve.</p> <p>(v) Personnel dealing with WESTPLAN - HAZMAT incidents in the area given ready access to a locality map of the Water Reserve and training to understand the potential impacts of spills on the groundwater resource.</p>	<p>(i) Meekatharra Local Emergency Management Advisory Committee through WRC (Mid-West Gascoyne Region).</p> <p>(ii) Program Manager, Protection Planning (WRC).</p> <p>(iii) Water Corporation.</p> <p>(iv) Regional Manager, Mid-West Gascoyne Region (WRC).</p> <p>(v) Meekatharra Local Emergency Management Advisory Committee.</p>	<p>(i) As soon as possible.</p> <p>(ii) As soon as possible.</p> <p>(iii) Ongoing.</p> <p>(iv) Ongoing.</p> <p>(v) As soon as possible.</p>

No	Description	Implemented by	Timing
5.	<p>Surveillance program:</p> <p>(i) Develop guidelines for the surveillance of Water Reserves.</p> <p>(ii) Consider delegation of surveillance and by-law enforcement to Water Corporation.</p> <p>(iii) Implement the surveillance program.</p>	<p>(i) Program Manager, Protection Planning (WRC).</p> <p>(ii) Program Manager, Protection Planning (WRC).</p> <p>(iii) Regional Business Manager, Mid-West (WC).</p>	<p>(i) 2001/02.</p> <p>(ii) 2001/02.</p> <p>(iii) On completion of surveillance guidelines.</p>
6.	<p>Monitoring program:</p> <p>i) Review water quality monitoring program to address parameters associated with land use risks.</p> <p>ii) Regularly review water quality data for adverse trends.</p>	<p>i) Water Corporation.</p> <p>ii) Water Corporation.</p>	<p>i) As soon as possible.</p> <p>ii) As necessary.</p>
7.	<p>Upgrade bunding of above ground fuel storage tanks at bores 5/85 and 12/85 or consider electrification.</p>	<p>Water Corporation.</p>	<p>To be determined.</p>
8.	<p>Installation of fences around production bores.</p>	<p>Regional Business Manager, Mid-West Region (WC)</p>	<p>To be determined.</p>
9.	<p>Review of this plan, recommendations and implementation strategy.</p>	<p>Water Quality Protection Branch (WRC).</p>	<p>(i) Implementation strategy – annually.</p> <p>(ii) Full review- 5 years.</p>

---

# Bibliography

Capital Engineering Pty Ltd 1997, *Meekatharra Water Source Review*, Report for Water Corporation, August 1997.

Coffey Partners International Pty Ltd, 1992, *Dominion Mining Ltd - Annual Borefield Review 1991/92 Meekatharra Operations*. Report No P435/3-AA.

Martin MW. 1994, *Meekatharra town water supply, groundwater source options*. Hydrogeological Report No 1994/55, Western Australian Geological Survey.

McGowan RJ. 1985, *Meekatharra Town Water Supply – A review of groundwater conditions*. Hydrogeological Report 2604, Western Australian Geological Survey.

National Health and Medical Research Council and Agricultural and Resource Management Council of Australia and New Zealand (NH&MRC and

ARMCANZ) 1996, *Australian Drinking Water Guidelines*.

Water and Rivers Commission 1999, *Water Quality Protection Guidelines (Nos. 1-11), Mining and Mineral Processing*, Water and Rivers Commission.

Water Authority of Western Australia *Groundwater Scheme Review Meekatharra*. Report No WG 42, April 1989.

Water Corporation 1998, *Meekatharra Source Investigation Plan*. IPB Report No A4-446.

Water Corporation 1998, *Meekatharra Water Resource Management Operation Strategy*. IPB Report No A4-456.



---

# Glossary

<b>Alluvium (alluvial)</b>	Detrital material which is transported by streams and rivers and deposited.
<b>Aquifer</b>	A geological formation or group of formations able to receive, store and transmit significant quantities of water.
<b>Bore</b>	A narrow, lined hole drilled to monitor or withdraw groundwater.
<b>Catchment</b>	The area of land which intercepts rainfall and contributes the collected water to surface water (streams, rivers, wetlands) or groundwater.
<b>Confined aquifer</b>	An aquifer that is confined between shale and siltstone beds and therefore contains water under pressure.
<b>Effluent</b>	The liquid, solid or gaseous wastes discharged by a process, treated or untreated.
<b>Groundwater</b>	Water which occupies the pores and crevices of rock or soil.
<b>Hydrogeology</b>	The study of groundwater, especially relating to the distribution of aquifers, groundwater flow and groundwater quality.
<b>m AHD</b>	Australian Height Datum. Height in metres above Mean Sea Level +0.026 m at Fremantle.
<b>Nutrient load</b>	The amount of nutrient reaching the waterway over a given time (usually per year) from its catchment area.
<b>Nutrients</b>	Minerals dissolved in water, particularly inorganic compounds of nitrogen (nitrate and ammonia) and phosphorus (phosphate) which provide nutrition (food) for plant growth. Total nutrient levels include the inorganic forms of an element plus any bound in organic molecules.
<b>Pesticides</b>	Collective name for a variety of insecticides, fungicides, herbicides, algicides, fumigants and rodenticides used to kill organisms.
<b>Pollution</b>	Water pollution occurs when waste products or other substances e.g. effluent, litter, refuse, sewage or contaminated runoff, change the physical, chemical, biological or thermal properties of the water, adversely affecting water quality, living species and beneficial uses.
<b>Public Drinking Water Source Area</b>	The collective term given to existing and future drinking water sources, identified by proclaiming Underground Water Pollution Control Areas, Water Reserves or Catchment Areas under the <i>Country Areas Water Supply Act 1947</i> , or the <i>Metropolitan Water Supply, Sewerage and Drainage Act 1909</i> .



---

<b>Recharge</b>	Water infiltrating to replenish an aquifer.
<b>Recharge Area</b>	An area through which water from a groundwater catchment percolates to replenish (recharge) an aquifer. An unconfined aquifer is recharged by rainfall throughout its distribution. Confined aquifers are recharged in specific areas where water leaks from overlying aquifers, or where the aquifer rises to meet the surface.
<b>Runoff</b>	Water that flows over the surface from a catchment area, including streams.
<b>Scheme supply</b>	Water diverted from a source (or sources) by a water authority or private company and supplied via a distribution network to customers for urban, industrial or irrigation use.
<b>Stormwater</b>	Rainwater that has run off the ground surface, roads, paved areas etc and is usually carried away by drains.
<b>Treatment</b>	Application of techniques such as settlement, filtration and chlorination to render water suitable for specific purposes including drinking and discharge to the environment.
<b>Unconfined aquifer</b>	An aquifer with no upper non-porous material to limit its volume or to exert pressure. The upper surface of the groundwater within the aquifer is called the watertable.
<b>Water Reserve</b>	An area proclaimed under the Metropolitan Water Supply Sewerage and Drainage Act or Country Areas Water Supply Act to allow the protection and use of water on or under the land for public water supplies
<b>Wastewater</b>	Water that has been used for some purpose and would normally be treated and discarded. Wastewater usually contains significant quantities of pollutant.
<b>Water quality</b>	The physical, chemical and biological measures of water.
<b>Watertable</b>	The upper saturated level of the unconfined groundwater.
<b>Wellfield</b>	A group of bores to monitor or withdraw groundwater.



---

# Appendix 1

Acceptability of land uses within Public Drinking Water Source Areas



## LAND USE COMPATIBILITY IN PUBLIC DRINKING WATER SOURCE AREAS

### Purpose

These notes provide the Commission's views on practices and activities related to the quality of the State's water resources. They are recommendations only, and may be varied at the discretion of the Commission.

The notes provide a basis for developing formal guidelines in consultation with key stakeholders.

### Scope

These notes apply to land use within Public Drinking Water Source Areas (PDWSAs).

PDWSAs include Underground Water Pollution Control Areas, Water Reserves and public water supply Catchment Areas declared under the *Metropolitan Water Supply, Sewerage and Drainage Act 1909*, and the *Country Areas Water Supply Act 1947*.

The notes are not intended to override the statutory role and policy of other State or local government authorities. Project proponents will need to fulfil their legal responsibilities including those covering land use planning, environmental, health and building permit matters.

### PDWSA Protection Framework

The Water and Rivers Commission is responsible for managing and protecting Western Australia's water resources. The Commission has policies for the protection of public drinking water source areas that include three levels of priority classification of lands within PDWSAs.

**Priority 1 (P1)** source protection areas are defined to ensure that there is **no degradation** of the water source. P1 areas are declared over land where the provision of the highest quality public drinking water is the prime beneficial land use. P1 areas would typically include land under Crown ownership. P1 areas are managed in accordance with the principle of **risk avoidance** and so land development is generally not permitted.

**Priority 2 (P2)** source protection areas are defined to ensure that there is **no increased risk of pollution** to the water source. P2 areas are declared over land where low intensity development (such as rural) already exists. Protection of public water supply sources is a high priority in these areas. P2 areas are managed in accordance with the principle of **risk minimisation** and so conditional development is allowed.

---

**Priority 3 (P3)** source protection areas are defined to **manage the risk of pollution** to the water source. P3 areas are declared over land where water supply sources need to co-exist with other land uses such as residential, commercial and light industrial developments.

Protection of P3 areas is achieved through **management guidelines** for land use activities. If the water source does become contaminated, then water may need to be treated or an alternative water source found.

In addition to priority classifications, **well-head protection zones** and **reservoir protection zones** are defined to protect the water source from contamination in the immediate vicinity of production wells and reservoirs. Well-head protection zones are usually circular, with a radius of 500 metres in P1 areas and 300 metres in P2 and P3 areas. Reservoir protection zones usually consist of a 2 kilometre buffer area around the top water level of a reservoir and include the reservoir itself. These zones do not extend outside water reserves. Special conditions apply within these zones.

### **Tables showing land use compatibility with the Commission's PDWSA protection strategy**

These tables should be used as a guideline only. More detailed information on the Commission's requirements in the form of activity guidelines or notes is available for some land uses. These can be found on the 'Protecting Water' web page on the Commission's Internet site ([www.wrc.wa.gov.au](http://www.wrc.wa.gov.au)). Alternatively information relating to land use and development within PDWSAs including those not listed in the tables, can be obtained from the Commission's Water Quality Protection Branch.

The Commission recognises that many activities were established before the introduction of these tables. The Commission will negotiate with the operators of such activities to develop appropriate management practices to minimise the impact on water resources.

These tables do not replace the need for activity assessment by the Commission. Please consult the Commission for advice on any land use proposals in Public Drinking Water Source Areas that may impact on water resources.

### **Definitions used in the following tables**

<i>Compatible</i>	The land use is compatible with the management objectives of the priority classification.
<i>Conditional</i>	The land use can be compatible with the management objectives of the priority classification, with appropriate site management practices. All conditional developments / activities should be referred to the Commission for assessment on a case specific basis.
<i>Incompatible</i>	The land use is incompatible with the management objectives of the priority classification. Any such development proposals received may be referred for formal Environmental Impact Assessment under Environmental Protection Act,
<i>Extensive</i>	Where limited additional inputs are required to support the desired land use. eg supplementary animal feed only during seasonal dry periods.
<i>Intensive</i>	Where regular additional inputs are required to support the desired land use. eg irrigation, fertilisers and non forage animal feed dominates.



---

## **More information**

We welcome your comment on these notes. They will be updated from time to time as comments are received or activity standards change. The Commission is progressively developing Water Quality Protection Notes and Guidelines covering land uses described in the following tables. Advice on available guidance documents may be obtained by contacting the Commission.

If you wish to comment on the notes or require more information, please contact the Commission's Water Quality Protection Branch at the Hyatt Centre in East Perth.

Phone: (08) 9278 0300 (business hours) or Fax:(08) 9278 0585.

E-mail: use the {feedback} section at our Internet address (<http://www.wrc.wa.gov.au>) citing the topic and version.



## Tables showing land -use compatibility with PDWSA protection objectives

### AGRICULTURE - ANIMALS

Land use	Priority 1	Priority 2	Priority 3
Animal saleyards and stockyards <sup>14</sup>	Incompatible	Incompatible <sup>7</sup>	Conditional <sup>7</sup>
Apiaries on Crown land	Conditional	Conditional	Conditional
Aquaculture eg. crustaceans, fish, algae	Incompatible	Conditional	Conditional
Dairy sheds	Incompatible	Incompatible <sup>11,15</sup>	Conditional <sup>15</sup>
Feedlots	Incompatible	Incompatible	Conditional
Livestock grazing - pastoral leases	Conditional	Compatible	Compatible
Livestock grazing - broad acre (extensive)	Incompatible	Conditional <sup>11</sup>	Compatible
Livestock grazing (intensive)	Incompatible	Incompatible	Conditional <sup>11</sup>
Piggeries	Incompatible	Incompatible	Incompatible
Poultry farming (housed)	Incompatible	Conditional	Conditional
Stables	Incompatible	Conditional	Compatible

### AGRICULTURE - PLANTS

Land use / practices	Priority 1	Priority 2	Priority 3
Broad land cropping i.e. non-irrigated	Incompatible	Conditional <sup>1</sup>	Compatible
Floriculture (extensive)	Incompatible	Conditional	Compatible
Floriculture (intensive)	Incompatible	Incompatible	Conditional
Horticulture- hydroponics	Incompatible	Conditional	Conditional
Horticulture - market gardens	Incompatible	Incompatible	Conditional
Orchards	Incompatible	Conditional	Compatible
Nurseries (potted plants)	Incompatible	Conditional	Compatible
Silviculture (tree farming)	Conditional	Conditional	Compatible
Soil amendment (clean sand, loam, clay, peat)	Incompatible	Conditional	Compatible
Soil amendment (industry byproducts & biosolids),	Incompatible	Incompatible	Conditional
Turf farms	Incompatible	Incompatible	Conditional
Viticulture (wine & table grapes)	Incompatible	Conditional	Compatible

### DEVELOPMENT - COMMERCIAL

Land use	Priority 1	Priority 2	Priority 3
Aircraft servicing	Incompatible	Incompatible	Conditional <sup>6</sup>
Airports or landing grounds	Incompatible	Incompatible	Conditional <sup>6</sup>
Amusement centres	Incompatible	Incompatible	Compatible <sup>6</sup>
Automotive businesses	Incompatible	Incompatible	Conditional <sup>6</sup>
Boat servicing	Incompatible	Incompatible	Conditional <sup>6</sup>
Catteries	Incompatible	Compatible	Compatible
Caravan and trailer hire	Incompatible	Incompatible	Conditional <sup>6</sup>
Chemical manufacture / formulation	Incompatible	Incompatible	Conditional <sup>6</sup>
Consulting rooms	Incompatible	Incompatible <sup>7</sup>	Compatible <sup>6</sup>
Concrete batching and cement products	Incompatible	Incompatible	Conditional
Cottage Industries	Conditional	Conditional	Compatible
Dog kennels	Incompatible	Conditional	Conditional
Drive in / take-away food shops	Incompatible	Incompatible	Compatible <sup>6</sup>



<b>Land use</b>	<b>Priority 1</b>	<b>Priority 2</b>	<b>Priority 3</b>
Drive -in theatres	Incompatible	Incompatible	Compatible <sup>6</sup>
Dry cleaning premises	Incompatible	Incompatible	Conditional <sup>6</sup>
Dye works	Incompatible	Incompatible	Conditional <sup>6</sup>
Farm supply centres	Incompatible	Incompatible <sup>7</sup>	Conditional
Fertiliser manufacture / bulk storage depots	Incompatible	Incompatible	Conditional
Fuel depots	Incompatible	Incompatible	Conditional
Garden centres	Incompatible	Incompatible	Compatible
Laboratories (analytical, photographic)	Incompatible	Incompatible	Conditional <sup>6</sup>
Markets	Incompatible	Incompatible	Compatible <sup>6</sup>
Mechanical servicing	Incompatible	Incompatible	Conditional <sup>6</sup>
Metal production / finishing	Incompatible	Incompatible	Incompatible
Milk transfer depots	Incompatible	Incompatible	Conditional
Pesticide operator depots	Incompatible	Incompatible	Incompatible
Restaurants and taverns	Incompatible	Incompatible	Compatible <sup>6</sup>
Service stations	Incompatible	Incompatible	Conditional <sup>6</sup>
Shops and shopping centres	Incompatible	Incompatible <sup>7</sup>	Compatible <sup>6</sup>
Transport & municipal works depots	Incompatible	Incompatible	Conditional
Vehicle parking (commercial)	Incompatible	Incompatible	Compatible
Vehicle wrecking and machinery	Incompatible	Incompatible	Conditional
Veterinary clinics / hospitals	Incompatible	Incompatible <sup>7</sup>	Conditional <sup>6</sup>
Warehouses	Incompatible	Incompatible <sup>7</sup>	Conditional <sup>6</sup>

### ***DEVELOPMENT - INDUSTRIAL***

<b>Land use</b>	<b>Priority 1</b>	<b>Priority 2</b>	<b>Priority 3</b>
Heavy Industry	Incompatible	Incompatible	Incompatible
Light or general Industry	Incompatible	Incompatible	Conditional <sup>6</sup>
Power Stations / Gasworks	Incompatible	Incompatible	Incompatible
Petroleum refineries	Incompatible	Incompatible	Incompatible

### ***DEVELOPMENT - URBAN***

<b>Land use</b>	<b>Priority 1</b>	<b>Priority 2</b>	<b>Priority 3</b>
Aged and dependent persons group dwellings	Incompatible	Incompatible	Compatible <sup>6</sup>
Cemeteries	Incompatible	Incompatible	Conditional
Civic buildings	Incompatible	Conditional <sup>7</sup>	Compatible <sup>6</sup>
Clubs -sporting or recreation	Incompatible	Conditional	Compatible <sup>6</sup>
Community halls	Incompatible	Conditional <sup>7</sup>	Compatible
Family day care centres	Incompatible	Incompatible <sup>7</sup>	Compatible <sup>6</sup>
Funeral parlours	Incompatible	Incompatible	Compatible <sup>6</sup>
Health centres	Incompatible	Incompatible	Compatible <sup>6</sup>
Hospitals	Incompatible	Incompatible	Conditional <sup>6</sup>
Medical, veterinary, dental centres	Incompatible	Incompatible	Compatible <sup>6</sup>
Toilet blocks and change rooms	Incompatible <sup>7</sup>	Conditional	Compatible



## **EDUCATION / RESEARCH**

<b>Land use</b>	<b>Priority 1</b>	<b>Priority 2</b>	<b>Priority 3</b>
Community education centres	Conditional <sup>7</sup>	Conditional <sup>7</sup>	Compatible <sup>6</sup>
Primary / Secondary Schools	Incompatible	Incompatible	Compatible <sup>6</sup>
Scientific Research	Conditional	Conditional	Compatible
Tertiary Education Facilities	Incompatible	Incompatible	Conditional <sup>6</sup>

## **EXPLORATION, MINING AND MINERAL PROCESSING**

<b>Land use</b>	<b>Priority 1</b>	<b>Priority 2</b>	<b>Priority 3</b>
Extractive industries (sand, clay, peat and rock)	Conditional <sup>2</sup>	Conditional <sup>2</sup>	Conditional <sup>2</sup>
Mineral and energy source exploration	Conditional <sup>4</sup>	Conditional <sup>4</sup>	Conditional <sup>4</sup>
Mining	Conditional <sup>4</sup>	Conditional <sup>4</sup>	Conditional <sup>4</sup>
Mineral processing	Incompatible	Incompatible	Conditional <sup>4</sup>
Oil or gas extraction / decontamination for transport	Conditional <sup>4</sup>	Conditional <sup>4</sup>	Conditional <sup>4</sup>
Tailings dams	Incompatible	Incompatible	Conditional <sup>4</sup>

## **PROCESSING OF ANIMALS / ANIMAL PRODUCTS**

<b>Land use</b>	<b>Priority 1</b>	<b>Priority 2</b>	<b>Priority 3</b>
Animal product rendering works	Incompatible	Incompatible	Incompatible
Abattoirs	Incompatible	Incompatible	Incompatible
Dairy product factories	Incompatible	Incompatible	Conditional <sup>6</sup>
Food Processing	Incompatible	Incompatible	Conditional <sup>6</sup>
Manure stockpiling /processing facilities	Incompatible	Incompatible <sup>7</sup>	Conditional
Tanneries	Incompatible	Incompatible	Incompatible
Wool-scourers	Incompatible	Incompatible	Incompatible

## **PROCESSING OF PLANTS / PLANT PRODUCTS**

<b>Land use</b>	<b>Priority 1</b>	<b>Priority 2</b>	<b>Priority 3</b>
Breweries	Incompatible	Incompatible	Conditional <sup>6</sup>
Composting / soil blending (commercial)	Incompatible	Incompatible	Conditional
Forestry product processing- pulp & paper, timber preservation, or wood fibre works	Incompatible	Incompatible	Conditional
Vegetable / food processing	Incompatible	Incompatible	Conditional <sup>6</sup>
Wineries	Incompatible	Conditional <sup>15, 18</sup>	Conditional <sup>15</sup>

## **SUBDIVISION**

<b>Land use</b>	<b>Priority 1</b>	<b>Priority 2</b>	<b>Priority 3</b>
Rural subdivision to a minimum lot size of 4 ha	Incompatible	Compatible	Compatible
Rural subdivision to a lot size less than 4 ha	Incompatible	Incompatible	Incompatible
Special rural subdivision to a minimum lot size of 2 ha	Incompatible	Conditional <sup>8,9</sup>	Conditional <sup>8</sup>



Land use	Priority 1	Priority 2	Priority 3
Special rural subdivision to a lot size between 1 and 2 ha	Incompatible	Incompatible	Conditional <sup>8,9</sup>
Special rural subdivision to a lot size less than 1 ha	Incompatible	Incompatible	Incompatible <sup>9</sup>
Urban subdivision	Incompatible	Incompatible	Compatible <sup>6</sup>
Industrial subdivision	Incompatible	Incompatible	Conditional <sup>6</sup>

**Note: Subdivision of lots to any size within Priority 1 areas is incompatible**

### **SPORT AND RECREATION**

Land use	Priority 1	Priority 2	Priority 3
Equestrian centres	Incompatible	Incompatible	Compatible
Golf courses	Incompatible	Incompatible	Conditional <sup>1</sup>
Motor sports ie permanent racing facilities	Incompatible	Incompatible	Conditional
Public swimming pools	Incompatible	Incompatible	Conditional
Recreational parks -irrigated	Incompatible	Incompatible	Conditional <sup>1</sup>
Rifle ranges	Incompatible	Conditional	Compatible

### **STORAGE/ PROCESSING OF TOXIC AND HAZARDOUS SUBSTANCES (THS)**

Land use	Priority 1	Priority 2	Priority 3
Above ground storage of THS	Conditional	Conditional	Conditional
Underground storage tanks for THS	Incompatible	Incompatible	Conditional

### **TOURISM ACCOMMODATION.**

Land use	Priority 1	Priority 2	Priority 3
Bed and breakfast accommodation	Incompatible	Conditional <sup>16</sup>	Compatible
Caravan parks	Incompatible	Incompatible	Conditional <sup>6</sup>
Farm stay accommodation	Incompatible	Conditional <sup>16</sup>	Compatible
Motels, hotels, lodging houses, hostels, resorts	Incompatible	Incompatible	Compatible <sup>6</sup>

### **WASTE TREATMENT AND MANAGEMENT**

Land use	Priority 1	Priority 2	Priority 3
Injection of liquid wastes into ground water	Incompatible	Incompatible	Incompatible
Landfills -Class I, II or III	Incompatible	Incompatible	Conditional
Landfills -Class IV and V	Incompatible	Incompatible	Incompatible
Recycling depots	Incompatible	Incompatible	Conditional
Refuse transfer stations	Incompatible	Incompatible	Conditional
Sewers (gravity)	Incompatible	Incompatible	Compatible
Sewers (pressure mains)	Incompatible	Conditional	Compatible
Sewage pump stations	Incompatible	Conditional	Conditional
Used tyre storage / disposal facilities	Incompatible	Incompatible	Incompatible
Wastewater treatment plants	Incompatible	Incompatible	Conditional
Wastewater application to land	Incompatible	Incompatible <sup>17</sup>	Conditional



## OTHER DEVELOPMENTS

Land use	Priority 1	Priority 2	Priority 3
Caretaker's housing	Incompatible <sup>7</sup>	Conditional	Compatible
Drinking water treatment plants	Conditional	Conditional	Conditional
Communications receivers / transmitters	Conditional	Conditional	Conditional
Construction projects (not shown elsewhere)	Conditional	Conditional	Conditional
Drinking water treatment plants	Conditional	Conditional	Conditional
Forestry	Conditional <sup>1</sup>	Compatible	Compatible
Major transport routes	Incompatible	Conditional <sup>10</sup>	Compatible
Construction /Mining camps,	Conditional	Conditional	Conditional
Prisons	Incompatible	Incompatible	Conditional <sup>6</sup>
National and Regional Parks <sup>13</sup>	Compatible	Compatible	Compatible
Nature reserves	Compatible	Compatible	Compatible

### Table reference notes:

1. Conditions may limit fertiliser and pesticide application.
2. Conditions cover the storage of fuels and chemicals, the depth of excavation in relation to the water table with specified guidelines for rehabilitation.
3. Conditions cover the storage and use of fuel and other chemicals.
4. Conditions placed via the Department of Minerals and Energy lease and / or Environment Minister's /Department of Environmental Protection approval.
5. Special rural development must have appropriate provisions under the Town Planning Scheme, to prevent introduction of land uses and practices that pose an unacceptable risk to water resources.
6. Must be connected to deep sewerage, except where exemptions apply under the current Government Sewerage Policy.
7. May be accepted if this facility is necessary to support acceptable land use in the area and is consistent with State and local government planning strategies.
8. Lots should only be created where land capability allows effective on-site soakage disposal of treated wastewater. Conditions apply to siting of wastewater disposal systems in areas with poor land drainage and / or a shallow depth to groundwater, animals are held or fertiliser is applied. Alternative wastewater treatment systems, where approved by the Health Department, may be accepted with maintenance requirements.
9. An average rather than minimum lot size may be acceptable if the proponent can demonstrate that the water quality objectives of the source protection area are met, and caveats are placed on titles of specified blocks stating that further subdivision cannot occur.
10. Conditions cover road design, construction and the types of goods that may be carried.



- 
11. May be permitted if animal stocking levels (number of animals per hectare) are consistent with source protection objectives.
  12. May be permitted if the type, volume and storage mechanisms for chemicals are compatible with water quality protection objectives.
  13. Visitor and management infrastructure and facilities must be appropriately sited and maintained.
  14. This does not include on-farm / pastoral lease stock-yards used for animal husbandry
  15. Waste management practices must be compatible with source protection objectives.
  16. Conditions apply on density of accommodation in Priority 2 areas
  17. May be permitted if the quantity and quality are compatible with water quality protection objectives.
  18. Size of annual grape crush does not exceed 500 tonnes and grapes sourced from operator's vineyards within the P2 area.



---



# Publication feedback form

The Water and Rivers Commission welcomes feedback to help us to improve the quality and effectiveness of our publications. Your assistance in completing this form would be greatly appreciated.

Please consider each question carefully and rate them on a 1 to 5 scale, where 1 is poor and 5 is excellent (*please circle the appropriate number*).

**Publication title** .....

*How did you rate the quality of information?*

1                      2                      3                      4                      5

*How did you rate the design and presentation of this publication?*

1                      2                      3                      4                      5

*How can it be improved?*

.....  
.....  
.....

*How effective did you find the tables and figures in communicating the data?*

1                      2                      3                      4                      5

*How can they be improved?*

.....  
.....  
.....

*How did you rate this publication overall?*

1                      2                      3                      4                      5

*If you would like to see this publication in other formats, please specify. (Eg. CD)*

.....

*Please cut along the dotted line on the left and return your completed response to:*

**Publications Coordinator  
Water and Rivers Commission  
Level 2, Hyatt Centre  
3 Plain Street  
East Perth WA 6004  
Fax: (08) 9278 0704**

